


NOTES :

1. SHALL BE IN ACCORDANCE WITH SECTION 206 OF THE R.I. STANDARD SPECIFICATIONS.
2. STD. 9.1.0 IS INSTALLED "TIGHT" AGAINST SILT FENCE. THOROUGHLY COMPACT EXCAVATED SOILS BACK INTO TRENCH AFTER INSTALLATION OF EROSION CONTROL DEVICE. SILT FENCE FABRIC SHALL NOT BE SLIT. STD. 9.1.0 POST SHALL BE DRIVEN THROUGH SILT FENCE FABRIC. 2"x2"x4'-6"(MAX.) OAK POST FOR SILT FENCE SHALL BE LOCATED 8'-0"(MAX.) O.C. IN WETLAND AREAS AND 4'-0"(MAX.) O.C. IN WETLAND RAVINE, GULLY OR DROP-OFF AREAS AS SHOWN ON PLANS.
3. 1"x1"x4'-6"(MIN.) POSTS PERMITTED FOR PRE-FABRICATED SILT FENCE.
4. SILT FENCE AND BALED HAY SHALL BE INSTALLED BEFORE ANY GRUBBING OR EARTH EXCAVATION TAKES PLACE.

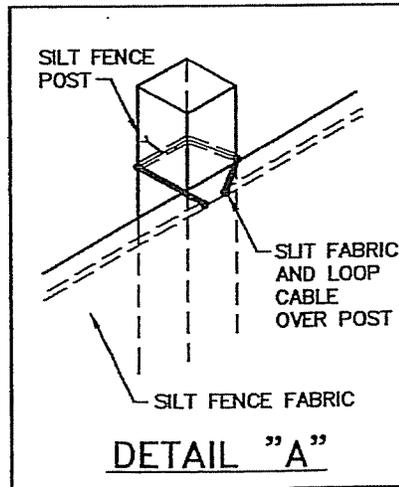

TOWN OF SOUTH KINGSTOWN DEPARTMENT OF PUBLIC SERVICES

REVISIONS		
NO.	BY	DATE

BALED HAY EROSION CHECK AND SILT FENCE COMBINED

WCB
TOWN ENGINEER

John R. Fisher
DIRECTOR OF PUBLIC SERVICES

12-6-10
ISSUE DATE

